



ABLE ENGINEERING SERVICES INC.
 4073 HIGHWAY #3
 P.O. BOX 989
 CHESTER, NOVA SCOTIA, B0J 1J0
 TEL. 1-833-766-8433
 FAX. 902-273-3072
 engineering@ableinc.ca

LEGEND


- TREE
- FOUND SURVEY MARKER SET (IRON BARK WITH CAP)
- SM
- POLE
- IB
- IRON PIPE (OR BAR)
- BOUNDARY LINE
- DITCH LINE - CENTER LINE OF DITCH
- CHWM - ORDINARY HIGH WATER MARK
- OWM - ORDINARY WATER MARK
- ROW - RIGHT OF WAY BOUNDARY

GENERAL NOTES:
 - DRAWING UNITS ARE IN METERS.
 - PROPERTY BOUNDARIES SHOWN HAVE BEEN DERIVED FROM NSPRD INFORMATION, SURVEY PLAN BY K. W. ROBB DATED 19...
 - THIS DRAWING PACKAGE IS NOT A PLAN OF SURVEY OR LOCATION CERTIFICATE
 - THE BOUNDARIES AND BUILDINGS SHOWN ON THIS PLAN ARE REPRESENTATION ONLY AND ARE SUBJECT TO A FIELD SURVEY


PROJECT
 LOT LR-1-X-Y
 PIERRE-LUC SEVIGNY
 1129 WEST PETPESWICK ROAD,
 WEST PETPESWICK
 PID: 41032590

DRAWING
 REPLACEMENT
 ON-SITE SEWAGE
 DISPOSAL SYSTEM
 EXISTING PLAN

DESIGNED A. VEINOTTE
 DATE 18 JULY 2019
 DRAWN M. ENGLAND
 DATE 18 JULY 2019
 CHECKED A. VEINOTTE
 DATE 18 JULY 2019
 APPROVED PIERRE-LUC SEVIGNY
 DATE 22 JULY 2019



PROJECT NO. **190717-05**
 DRAWING NO. **190717-05**
 REVISION
 SHEET NO. **1** OF **4**

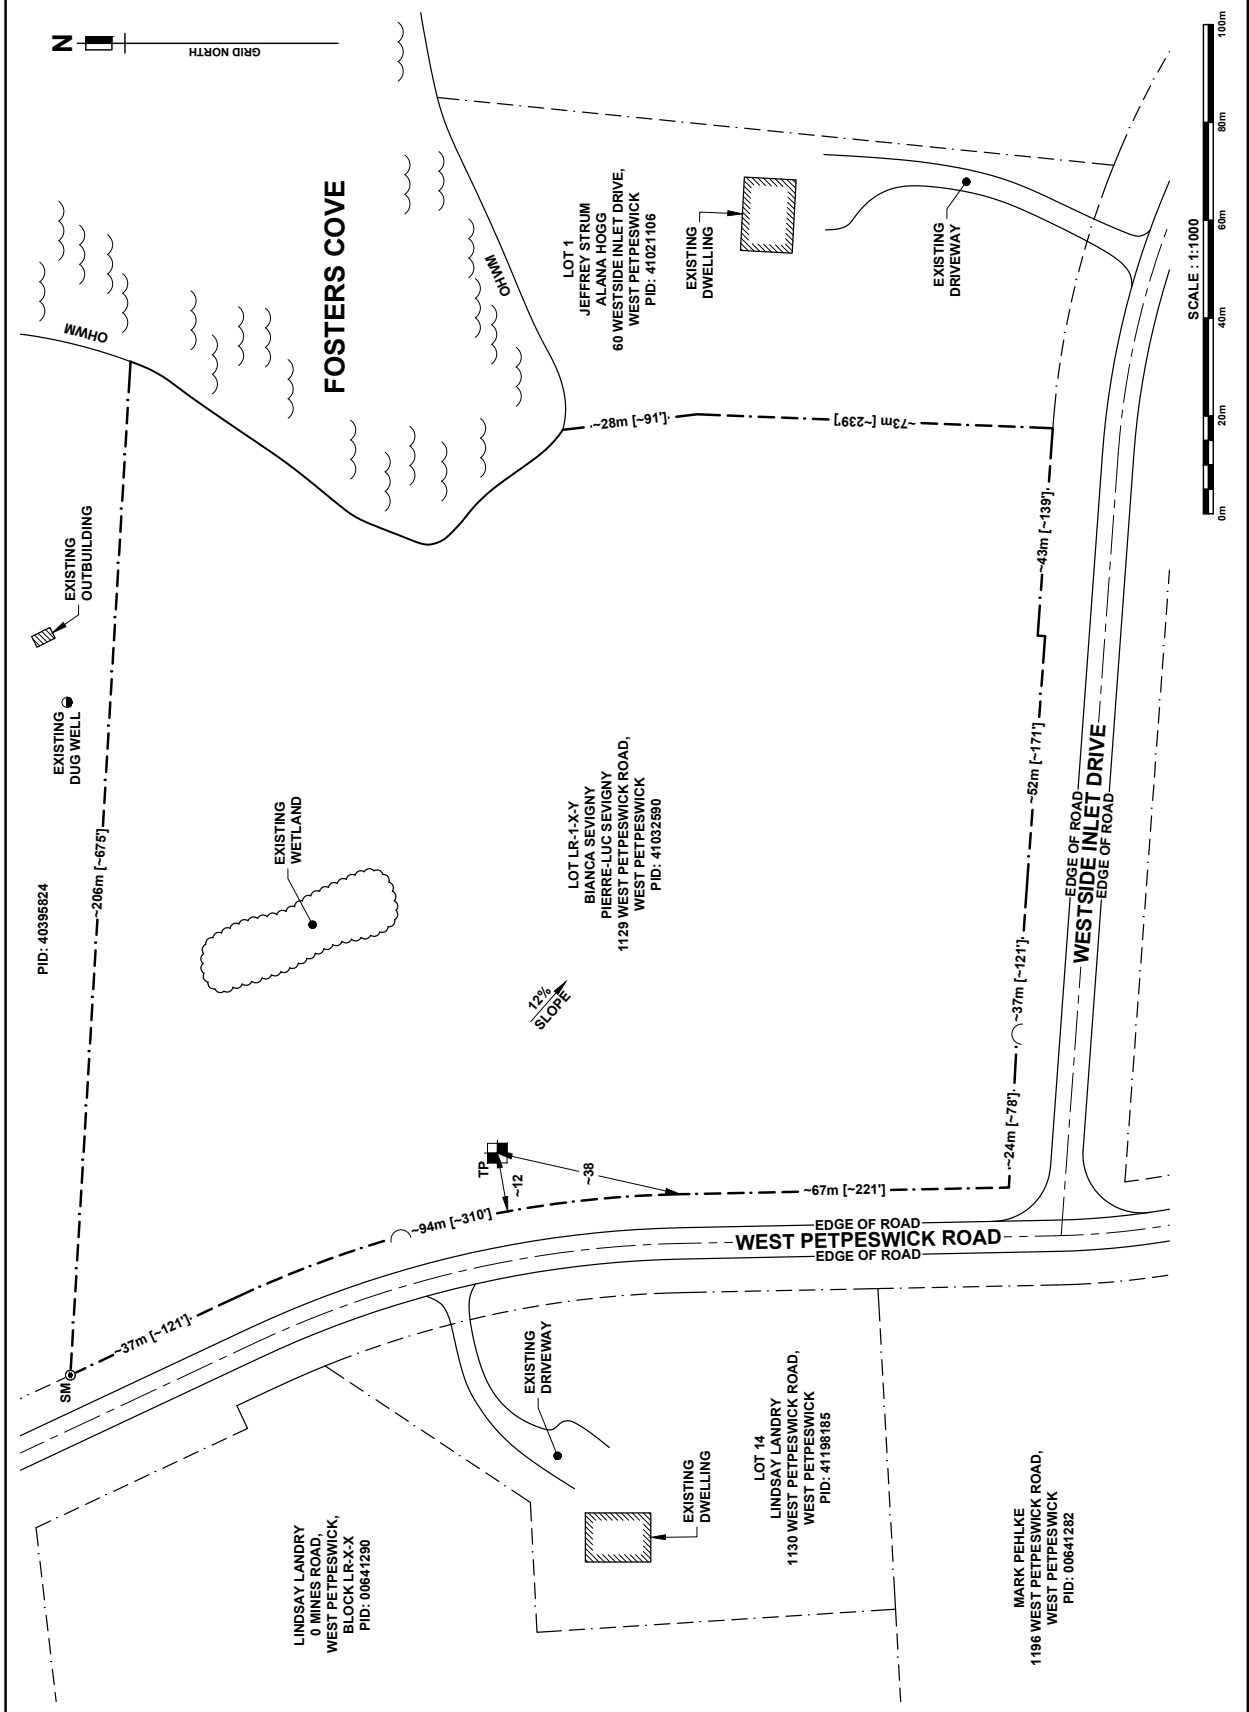



ABLE ENGINEERING SERVICES INC.
 4073 HIGHWAY #3
 P.O. BOX 959
 CHESTER, NOVA SCOTIA, B0J 1J0
 TEL. 1-833-756-8433
 FAX. 902-273-3072
 engineering@ableinc.ca

LEGEND

TREE
 FOUND SURVEY MARKER SET
 (IRON BAR WITH CAP)

SM
 POLE

IB
 IRON PIPE (OR BAR)


BOUNDARY LINE
 DITCH LINE - CENTER LINE OF DITCH
 CHWM - ORDINARY HIGH WATER MARK
 OWM - ORDINARY HIGH WATER MARK
 ROW - RIGHT OF WAY BOUNDARY

GENERAL NOTES:
 - DRAWING UNITS ARE IN METERS.
 - PROPERTY BOUNDARIES SHOWN HAVE BEEN DERIVED FROM NSPRD INFORMATION, SURVEY PLAN BY K. W. ROBB DATED 19...
 - THIS DRAWING PACKAGE IS NOT A PLAN OF SURVEY OR LOCATION CERTIFICATE
 - THE BOUNDARIES AND BUILDINGS SHOWN ON THIS PLAN ARE REPRESENTATION ONLY AND ARE SUBJECT TO A FIELD SURVEY


PROJECT
**LOT LR-1-X-Y
 PIERRE-LUC SEVIGNY
 1129 WEST PETPESWICK ROAD,
 WEST PETPESWICK
 PID: 41032590**

DRAWING
**REPLACEMENT
 ON-SITE SEWAGE
 DISPOSAL SYSTEM
 PROPOSED PLAN**

DESIGNED A. VEINOTTE
 DATE 18 JULY 2019
 DRAWN M. ENGLAND
 DATE 18 JULY 2019
 CHECKED A. VEINOTTE
 DATE 18 JULY 2019
 APPROVED PIERRE-LUC SEVIGNY
 DATE 22 JULY 2019




PROJECT NO. **190717-05**
 DRAWING NO. **190717-05**
 REVISION
 SHEET NO. **2** OF **4**

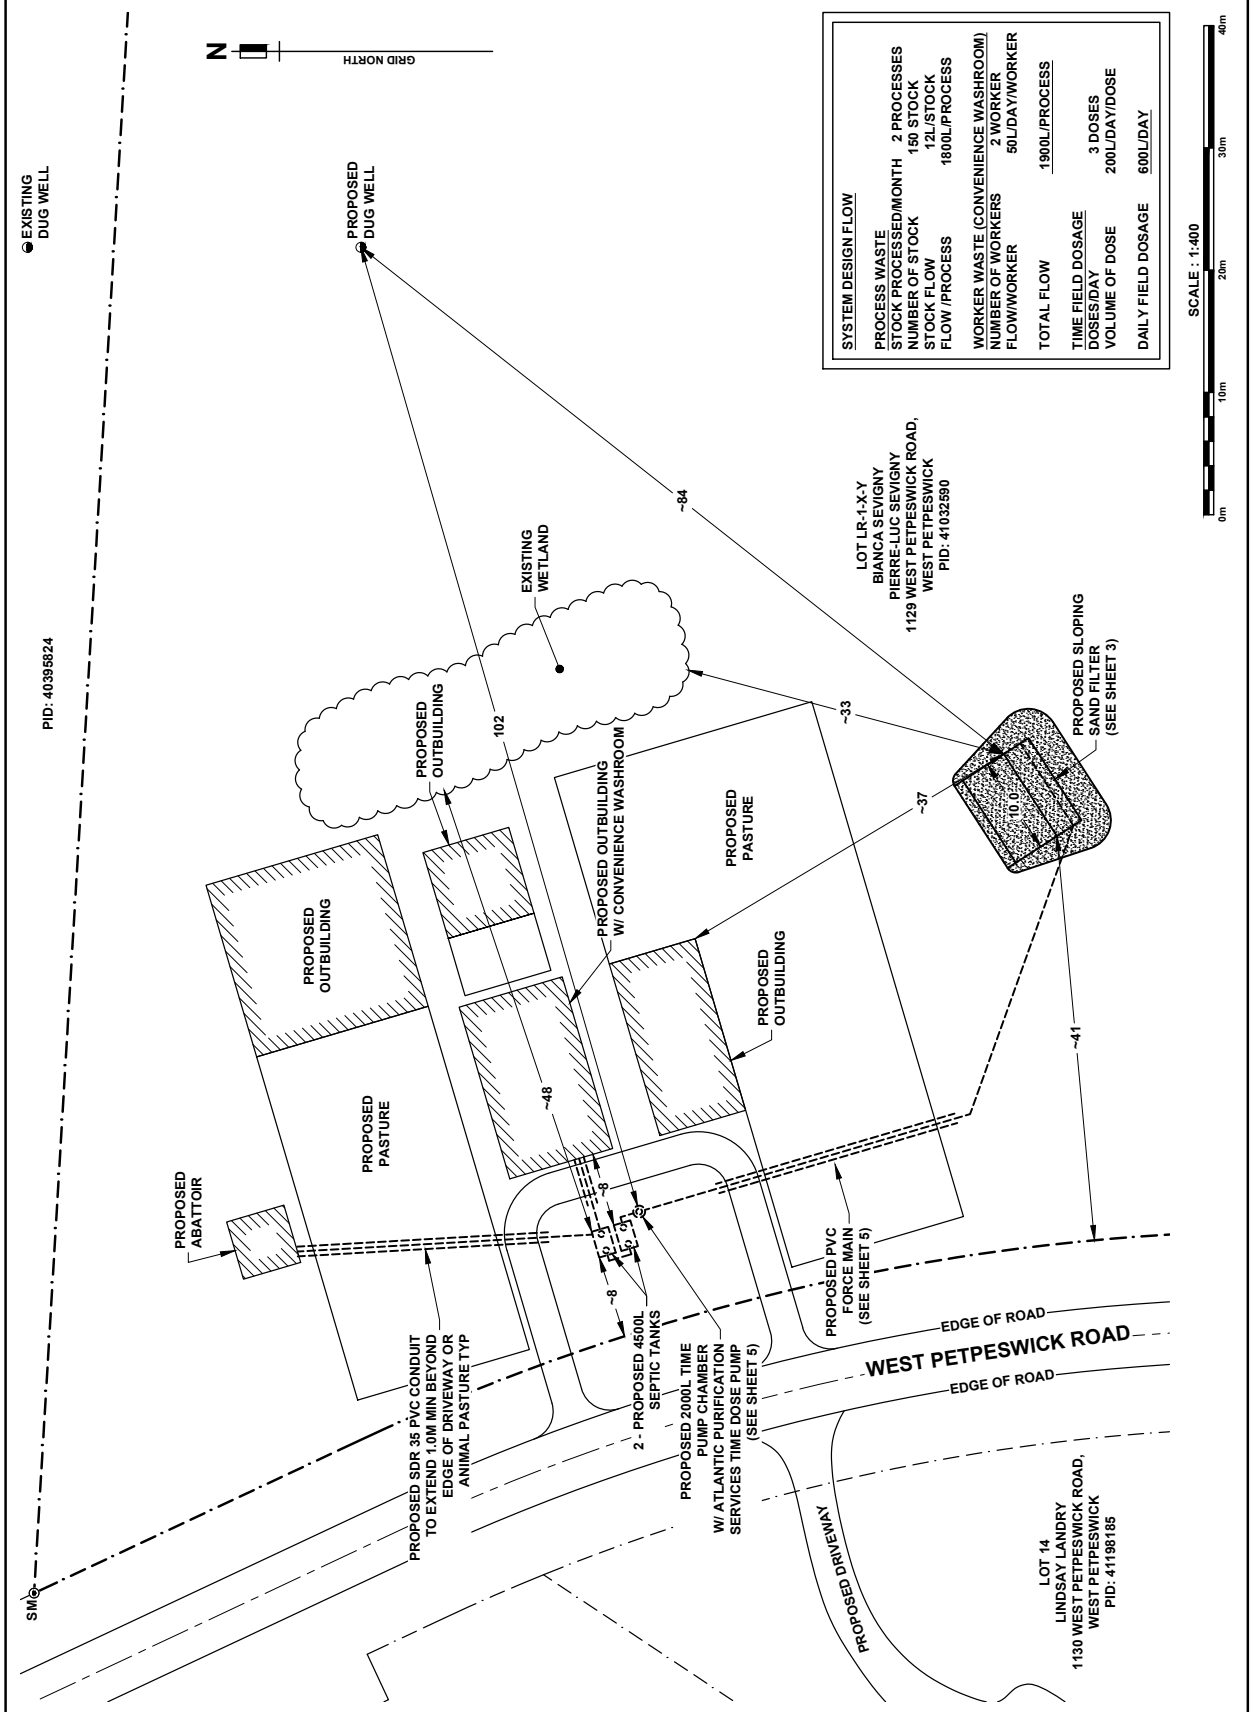

SYSTEM DESIGN FLOW

PROCESS WASTE	2 PROCESSES
STOCK PROCESSED/MONTH	2 STOCK
NUMBER OF STOCK	150 STOCK
STOCK FLOW	12L/STOCK
FLOW /PROCESS	1800L/PROCESS
WORKER WASTE (CONVENIENCE WASHROOM)	2 WORKER
NUMBER OF WORKERS	2 WORKER
FLOW/WORKER	50L/DAY/WORKER
TOTAL FLOW	1900L/PROCESS
TIME FIELD DOSAGE	3 DOSES
DOSE/DAY	200L/DAY/DOSE
VOLUME OF DOSE	600L/DAY
DAILY FIELD DOSAGE	600L/DAY



PID: 40395824

LOT 14
 LINDSAT LANDRY
 WEST PETPESWICK ROAD,
 WEST PETPESWICK
 PID: 41196185

WEST PETPESWICK ROAD



ABLE ENGINEERING SERVICES INC.
 4073 HIGHWAY #3
 P.O. BOX 959
 CHESTER, NOVA SCOTIA, B0J 1J0
 TEL. 1-833-756-8433
 FAX. 902-273-3072
 engineering@ableinc.ca

LEGEND
 --- BOUNDARY LINE
 - - - CENTER LINE OF DITCH
 OWM ORDINARY HIGH WATER MARK
 OWM ORDINARY HIGH WATER MARK
 ROW RIGHT OF WAY BOUNDARY

GENERAL NOTES:
 - DRAWING UNITS ARE IN METERS UNLESS OTHERWISE SPECIFIED


PROJECT
 LOT LR-1-X-Y
 PIERRE-LUC SEVIGNY
 1129 WEST PEPESWICK
 ROAD,
 WEST PEPESWICK
 PID: 41032590

DRAWING
 REPLACEMENT
 ON-SITE SEWAGE
 DISPOSAL SYSTEM
 SECTION AND DETAIL


DESIGNED A. VEINOTTE
 DATE 18 JULY 2019
 DRAWN M. ENGLAND
 DATE 18 JULY 2019
 CHECKED A. VEINOTTE
 DATE 18 JULY 2019
 APPROVED PIERRE-LUC SEVIGNY
 DATE 22 JULY 2019



PROJECT NO. 190717-05
 DRAWING NO. 190717-05
 REVISION -
 SHEET NO. 3 OF 4

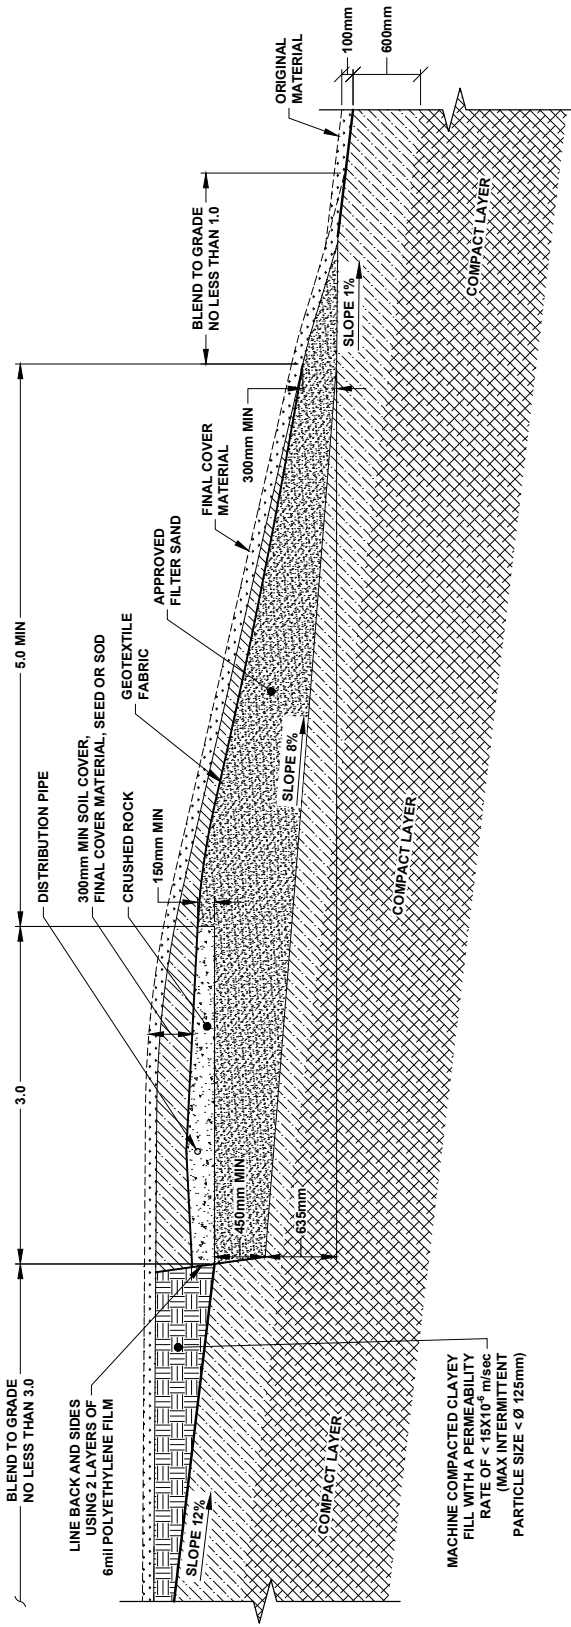

SLOPING SAND FILTER - TYPICAL SECTION VIEW
 SCALE: NTS

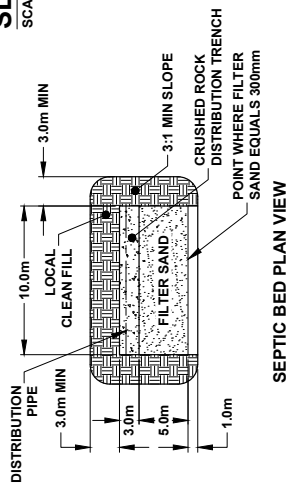

SEPTIC BED PLAN VIEW
 SCALE: NTS

GENERAL CONDITIONS

CONTRACTOR SHALL VERIFY LOCATION OF ALL WELLS, WATERCOURSES, LOT BOUNDARIES AND ALL ELEVATIONS PRIOR TO CONSTRUCTION (WITHIN 30.5m FROM THE LOCATION OF DISPOSAL SYSTEM)

BACKWASH WATER FROM WATER TREATMENT DEVICES MUST NOT BE DISCHARGED TO THE ON-SITE SEWAGE DISPOSAL SYSTEM.

ROOF, FOUNDATION AND LOT DRAINAGE MUST BE DIRECTED AWAY FROM THE DISPOSAL FIELD, SEPTIC TANK AND PUMP (SIPHON) CHAMBER.

STEPS MUST BE TAKEN TO ENSURE THAT THE AREA IS NOT SUBJECT TO VEHICULAR TRAFFIC OF ANY OTHER DISTURBANCE SUCH AS EXCAVATION OR STOCKPILING OF EXCAVATED MATERIAL ETC., INSTALLATION OF A PHYSICAL BARRIER IS RECOMMENDED.

IT IS THE OWNERS RESPONSIBILITY TO ASSURE THAT THE CONSTRUCTION OF FOUNDATIONS, DRIVEWAY, WELL OR ANY OTHER DEVELOPMENT ON THE LOT WILL NOT IMPACT ON THE FEASIBILITY OF ON-SITE SEWAGE DISPOSAL FIELD INSTALLATION.

DISPOSAL SYSTEM MUST BE INSTALLED BY A CONTRACTOR LICENSED TO INSTALL ON-SITE SEWAGE DISPOSAL SYSTEMS IN NOVA SCOTIA.

ALL WORK MUST BE COMPLETED IN ACCORDANCE WITH THE NOVA SCOTIA ON-SITE SEWAGE DISPOSAL SYSTEMS REGULATIONS, ON-SITE SEWAGE SYSTEMS STANDARD AND CONDITIONS OF THIS APPROVAL.

APPROXIMATE MATERIAL REQUIREMENTS

6.3 [8.2]	m ³ [yd ³]	CRUSHED ROCK
47.5 [62.1]	m ³ [yd ³]	APPROVED FILTER SAND
11.8 [15.4]	m ³ [yd ³]	LOCAL CLEAN FILL

ALL MATERIAL REQUIREMENT VALUES ARE APPROXIMATE AND DO NOT INCLUDE MATERIAL BEYOND LENGTH OF DISTRIBUTION TRENCH

SELECTION CRITERIA

FLOW (l/d)	600	AUTHORIZED	PIERRE-LUC SEVIGNY
SLOPE	8%	NOTIFICATION/ APPROVAL #/ EXPIRY DATE:	2019-259090-00 22 JULY 2022
SOIL TYPE	FILTER SAND	LOCATION	1129 WEST PEPESWICK ROAD, WEST PEPESWICK
SOIL DEPTH	300mm	APPLICANT	ANDRE VEINOTTE P. ENG

DISPOSAL FIELD REQUIREMENTS

100	mm	FINAL COVER MATERIAL, SEED OR SOD	
200 TO 350	mm	CLEAN LOCAL PERMEABLE BACKFILL	
75	mm	CRUSHED ROCK OVER PIPE	
50	mm	DISTRIBUTION PIPE DIAMETER	
10.0	m	DISTRIBUTION PIPE LENGTH	
125	mm	CRUSHED ROCK BELOW PIPE	
450	mm	FILTER SAND	
		PERMEABILITY m/s	5E-4 TO 1E-4
		MINUTES AT 20°C	1.8 TO 10.0



ABLE ENGINEERING SERVICES INC.
4073 HIGHWAY #3
P.O. BOX 959
CHESTER, NOVA SCOTIA, B0J 1J0
TEL. 1-833-756-8433
FAX. 902-273-3072
engineering@ableinc.ca

EXISTING DISPOSAL FIELD: (IF APPLICABLE)
ALL EXISTING DISPOSAL FIELD MATERIAL SHALL BE DISPOSED OF AS DIRECTED BY THE ENGINEER.
EXISTING GROUND MATERIAL SHALL BE EXCAVATED TO A DEPTH AS DIRECTED BY THE ENGINEER.
ALL EXISTING DISPOSAL AREA BED MATERIAL SHALL BE REPLACED WITH BACKFILL MATERIAL SPECIFIED HEREIN
OR AS APPROVED BY THE ENGINEER.

EXISTING SEPTIC TANK: (IF APPLICABLE)
WHERE A SEPTIC TANK IS EXISTING, AND NOT BEING REUSED, THE TANK SHALL BE DECOMMISSIONED AS
DIRECTED BY THE ENGINEER.

LAUNDRY FACILITY SPECIFICATIONS:
IT IS RECOMMENDED THAT ALL WASHING MACHINES HAVE A LINT FILTER ATTACHED TO THE OUTLET PIPE AS
SPECIFIED HEREIN.
LINT FILTER SHALL BE SUPPLIED BY ENVIRONMENTAL ENHANCEMENTS, DARTMOUTH, NOVA SCOTIA. FILTER
SHALL BE THE "LINT LUV-R" MODEL. FILTER UNIT SHALL BE INSTALLED AS PER MANUFACTURERS
INSTRUCTIONS DIRECTLY TO EACH WASHING MACHINE. EQUIVALENT UNITS WILL BE ACCEPTED UPON REVIEW
BY THE ENGINEER.

IMPORTED FILTER SAND SPECIFICATIONS:
CONTRACTOR SHALL PROVIDE THE SOURCE OF IMPORTED FILTER SAND AND RECENT PERTINENT PERMEABILITY
TEST RESULTS IN WRITING TO THE ENGINEER PRIOR TO SHIPPING ANY MATERIAL.
THE ENGINEER RESERVES THE RIGHT TO TEST ALL IMPORTED SAND PRIOR TO INSTALLATION.
THE ENGINEER RESERVES THE RIGHT TO TEST ALL IMPORTED SAND AFTER SAND INSTALLATION AND PRIOR TO
ANY OTHER WORK. APPROVAL OF IMPORTED SAND WILL BE BASED ON IN-PLACE FIELD TESTS TAKEN AFTER
INSTALLATION.
ANY SAND INSTALLED WITHOUT PRIOR APPROVAL BY THE ENGINEER MAY NOT BE ACCEPTED AND MAY BE
REQUIRED TO BE REMOVED.

SEPTIC TANK/ PUMP CHAMBER:
ACCEPTABLE MATERIALS ARE REINFORCED CONCRETE, FIBERGLASS OR POLYETHYLENE.
CONCRETE MINIMUM STRENGTH: 4000 PSI (28 MPa) AT 28 DAYS.
AIR ENTRAINING: 5-7% STRUCTURAL FIBER REINFORCEMENT.
CONSTRUCTION JOINTS TO BE SEALED WITH BUTYL ROPE OR EQUIVALENT.
MAXIMUM BURY: 5 FEET (1.5 METERS)
ALL TANKS, RISERS, AND COVERS MUST BE WATER TIGHT.
ALL TANKS MUST BE ASSEMBLED AND INSTALLED AS PER MANUFACTURERS INSTRUCTIONS.
TANKS MUST INCLUDE A WATER TIGHT ACCESS FOR MAINTENANCE, INSPECTION AND PUMP OUT.
EFFLUENT FILTERS MUST BE INSTALLED AT EXIT T-HOUSING OF ALL SEPTIC TANKS.
TANKS TO HAVE WATER TIGHT RISERS INSTALLED. ALL RISERS TO EXTEND NO LESS THAN 100mm ABOVE GRADE.
AREA AROUND RISER TO BE GRADED TO DIVERT SURFACE DRAINAGE.
ALL TANK STRUCTURES TO HAVE MINIMUM 150mm COMPACTED DEPTH OF 25mm DIA. CRUSHER RUN GRAVEL OR
25mm DIA. CLEAR CRUSHED STONE BEDDING.

TOPSOIL, SEED AND SOD:
ALL DISTURBED GROUND TO BE COVERED WITH A MINIMUM 100MM OF TOPSOIL, UNLESS OTHERWISE APPROVED
BY THE ENGINEER, AND SEED OR COVERED WITH SOD.
PRIOR TO PLACEMENT OF TOPSOIL, MATERIAL LARGER THAN 200MM IN DIAMETER MUST BE REMOVED FROM THE
DISTURBED SURFACE.
SHOULD SEASONAL CONDITIONS PROHIBIT THE PLACEMENT OF SEED OR SOD, ALL DISTURBED GROUND SHALL
BE COVERED WITH STRAW OR MULCH OR OTHER MATERIAL TO PREVENT EROSION UNTIL SUCH A TIME THAT
SEEDING OR SOD MAY BE PLACED.
IT IS THE CONTRACTORS RESPONSIBILITY TO COMPLETE SEEDING OR SODDING WHEN SEASONAL CONDITIONS
PERMIT.
IT IS RECOMMENDED THAT MULCH OR STRAW BE PLACED AFTER SEEDING TO PROMOTE GROWTH.

INSPECTIONS:
THE ENGINEER MAY INSPECT ALL PHASES OF THE WORK INCLUDING THE FOLLOWING:
- EXISTING SITE PRIOR TO START OF ANY CONSTRUCTION TO VERIFY LOCATION OF DISPOSAL FIELD.
- PRIOR TO PLACEMENT OF SAND FILL AFTER SITE PREPARATION AND GRUBBING.
- PRIOR TO COVERING DISTRIBUTION PIPE WITH GRAVEL.
- PUMPED SYSTEMS MUST BE PRESSURE TESTED WITH WATER PRIOR TO COVERING DISPOSAL FIELD.
- AFTER TOPSOIL INSTALLATION.
- AFTER INTERIM SOIL STABILIZATION.
- AFTER GRASS HAS ROOTED.
- FINAL APPROVAL WILL NOT BE GRANTED UNTIL FINISHED GRADE SURFACE HAS BEEN GRADED ACCORDING TO
DESIGN AND ALL DISTURBED SOIL STABILIZED WITH GRASS.

GENERAL SPECIFICATIONS:
• ALL CONSTRUCTION WORK AND INSTALLATION METHODS AND PRACTICES SHALL BE IN ACCORDANCE WITH ALL
MANUFACTURERS INSTRUCTIONS, AND THE NSE ON-SITE SEWAGE DISPOSAL SYSTEMS STANDARD OR AS
DIRECTED BY THE ENGINEER.
• ALL ELECTRICAL WORK SHALL BE INSTALLED ACCORDING TO ALL APPLICABLE ELECTRICAL CODES AND
CARRIED OUT AND CERTIFIED IN WRITING BY A LICENSED ELECTRICIAN.
• PROPERTY BOUNDARIES SHOWN ARE ONLY APPROXIMATE AND SHALL BE VERIFIED ON SITE BY THE
CONTRACTOR AS REQUIRED PRIOR TO CONSTRUCTION.
• ANY ERRORS OR OMISSIONS FOUND IN THESE PLANS AND SPECIFICATION SHALL BE IMMEDIATELY BROUGHT TO
THE ATTENTION OF THE ENGINEER.


• UNSUITABLE SOIL CONDITIONS ENCOUNTERED DURING CONSTRUCTION MUST BE BROUGHT TO THE ATTENTION
OF THE ENGINEER AND ADDITIONAL GRAVEL BEDDING MAY BE REQUIRED.
• ALL STRUCTURES, TANKS, PIPES, MATERIALS AND DEVICES SHALL BE INSTALLED OR AS SHOWN ON THESE
PLANS OR AS PER THE ON-SITE SEWAGE DISPOSAL SYSTEMS STANDARD OR AS DIRECTED BY THE ENGINEER.
PIPING:
• ALL BUILDING SEWER GRAVITY PIPE TO BE 100mm DIAMETER PVC SDR 35 (CSA-B137.0-02 OR CSA B-182.1) WITH
MINIMUM 2% SLOPE.
• ALL GRAVITY DISTRIBUTION PIPES SHALL HAVE A MINIMUM SLOPE OF 50-100mm PER 30 METERS OF LENGTH,
AND CONFORM TO CSA B-182.1 WITH HOLE SPACING AS SHOWN IN DIAGRAM 3D OF NSE ON-SITE SEWAGE
DISPOSAL SYSTEMS STANDARD.
• UNLESS OTHERWISE SPECIFIED, ALL PRESSURIZED DISTRIBUTION PIPE SHALL HAVE NO SLOPE AND IS TO BE
60mm SOLID PIPE WITH FIELD DRILLED HOLES UNLESS OTHERWISE SPECIFIED.
• UNLESS OTHERWISE SPECIFIED PRESSURIZED DISTRIBUTION PIPE HOLES SHALL BE FIELD DRILLED 11mm
DIAMETER AND SPACED AT 1.0m OVER THE LENGTH OF THE PIPE OR AS PROVIDED BY THE ENGINEER.
• ALL PUMP SYSTEMS SHALL BE CONNECTED TO THE DISPOSAL FIELD BY A "SIPHON BREAKER".
• ALL SYSTEMS USING AN "EVENDOSE" LOW PRESSURE MICRO DOSING SYSTEM SHALL HAVE THE DISTRIBUTION
PIPE SLOPE, HOLE SIZES AND SPACING SET AS PER THE MANUFACTURERS INSTRUCTIONS OR AS DIRECTED BY
THE ENGINEER.
• ALL PIPE TO PIPE AND PIPE TO STRUCTURE CONNECTIONS TO BE SECURELY FITTED OR GLUED TO PROVIDE A
WATER TIGHT SEAL.

BACKFILL MATERIAL AND PROCEDURES:
• NO BACKFILL MATERIAL SHALL BE PLACED ON SITE WITHOUT APPROVAL BY THE ENGINEER.
• CONTRACTOR SHALL PROVIDE THE SOURCE OF BACKFILL MATERIAL IN WRITING PRIOR TO INSTALLING ON SITE.
• STRUCTURAL BACKFILL MATERIAL SHALL BE COMPACTED IN LAYERS OF THICKNESS SPECIFIED BY THE
ENGINEER.
SUB-DRAIN AND INTERCEPTOR TRENCH SPECIFICATIONS:
• SWALE DITCH SHALL HAVE MINIMUM 2% SLOPE AND BE CONSTRUCTED TO CREATE POSITIVE DRAINAGE AWAY
FROM THE DISPOSAL FIELD.
• SUB-DRAIN PIPE TO BE FLEXIBLE PLASTIC 4" PERFORATED BIG-O OR EQUIVALENT.
• SUB-DRAIN TRENCH DEPTH TO BE DETERMINED BY THE ENGINEER DURING CONSTRUCTION.
• SUB-DRAIN TRENCH TO HAVE MINIMUM 2% POSITIVE SLOPE.
• SUB-DRAIN TRENCH TO BE FILLED WITH Ø25mm CLEAR STONE.
• SUB-DRAIN TRENCH TO BE COVERED WITH GEOTEXTILE FABRIC AND EXTENDED DOWN EACH SIDE OF TRENCH
TO MIN 300mm DEPTH.

PUMP AND EFFLUENT FORCE MAIN SPECIFICATIONS (WHERE INCLUDED IN SYSTEM DESIGN):
• ALL FORCE MAIN PIPE TO BE CONTINUOUS LENGTH.
• ALL FORCE MAIN PIPE TO HAVE MINIMUM 100mm SAND BEDDING.
• ALL PIPE SHALL HAVE A MINIMUM GROUND COVER OF 450mm.
• PUMP CHAMBER SHALL BE FITTED WITH EFFLUENT PUMP (AS SPECIFIED HEREIN).
• PUMP SHALL BE SET UP TO PROVIDE DOSING VOLUME OF 200 LITERS OR AS DIRECTED BY THE ENGINEER
FACILITY.
• PUMP SHALL BE EQUIPPED WITH A HIGH LEVEL ALARM PROVIDING AUDIBLE AND VISUAL ALERT WITHIN THE
FACILITY.
• EFFLUENT PUMP IS TO MEET OR EXCEED FLOW SPECIFICATIONS WITH HIGH LEVEL ALARM AS APPROVED BY THE
ENGINEER.
• ELECTRICAL PANEL TO BE RATED FOR THIS APPLICATION AS APPROVED BY THE ENGINEER.
• ELECTRICAL JUNCTION BOX TO BE WATERPROOF AND LOCATED 1.0m ABOVE GROUND, MOUNTED ON 4x4 PT
WOOD POST.
• ALL ELECTRICAL WIRING TO BE CONTAINED IN WATERPROOF CONDUIT.
• FORCE MAIN PIPING BURIED UNDER ROADWAYS SHALL BE PROTECTED BY SECONDARY ENCLOSURE TO
PREVENT CRUSHING.

SPECIAL NOTES:
• BACKFILL AGAINST FOUNDATION TO BE GRADED TO SLOPE AWAY FROM DISPOSAL FIELD.
• ALL ROOF DRAINS TO DISCHARGE AWAY FROM DISPOSAL FIELD.
• PROPOSED DRIVEWAYS SHOWN ARE FOR REFERENCE ONLY. ACTUAL DRIVEWAY
LOCATION IS BY OTHERS. RECEIVING APPROVAL FROM NSIR AND IN ACCORDANCE
WITH ANY AND ALL APPLICABLE PROVINCIAL, MUNICIPAL AND LOCAL BYLAWS.

PROJECT	LOT LR-1-X-Y PIERRE-LUC SEVIGNY 1129 WEST PETESPWICK ROAD, WEST PETESPWICK PID: 41032590
DRAWING	REPLACEMENT ON-SITE SEWAGE DISPOSAL SYSTEM SPECIFICATIONS
DESIGNED	A.VEINOTTE
DATE	18 JULY 2019
DRAWN	M.ENGLAND
DATE	18 JULY 2019
CHECKED	A.VEINOTTE
DATE	18 JULY 2019
APPROVED	PIERRE-LUC SEVIGNY
DATE	22 JULY 2019



PROJECT NO.	190717-05
DRAWING NO.	190717-05
REVISION	-
SHEET NO.	4 of 4




ABLE ENGINEERING SERVICES INC.
 4073 HIGHWAY #3
 P.O. BOX 989
 CHESTER, NOVA SCOTIA, B0J 1J0
 TEL. 1-833-786-8433
 FAX. 902-273-3072
 engineering@ableinc.ca

GENERAL NOTES:
 -DRAWING UNITS ARE IN METERS UNLESS OTHERWISE SPECIFIED.

PROJECT **LOT LR-1-X-Y**
PIERRE-LUC SEVIGNY
1129 WEST PETPESWICK ROAD,
WEST PETPESWICK
PID: 41032590

DRAWING **REPLACEMENT ON-SITE SEWAGE DISPOSAL SYSTEM PUMP CHAMBER**

DESIGNED **A.VEINOTTE**
 DATE **18.JULY.2019**
 DRAWN **M.ENGLAND**
 DATE **18.JULY.2019**
 CHECKED **A.VEINOTTE**
 DATE **18.JULY.2019**
 APPROVED **PIERRE-LUC SEVIGNY**
 DATE **22.JULY.2019**




PROJECT NO. **190717-05**
 DRAWING NO. **190717-05**
 REVISION **-**
 SHEET NO. **5** OF **4**

NOTES

CONTROL PANEL TO BE PLACED IN BUILDING OR WATERTIGHT ENCLOSURE - ALARM AND PUMP ON SEPARATE CIRCUITS.

THE SYSTEM MUST BE ALLOWED TO DRAIN BACK INTO THE PUMP CHAMBER WHEN THE PUMP IS NOT IN OPERATION.

TIME FIELD DOSAGE	3 DOSES
DOSES/DAY	200L/DAY/DOSE
VOLUME OF DOSE	

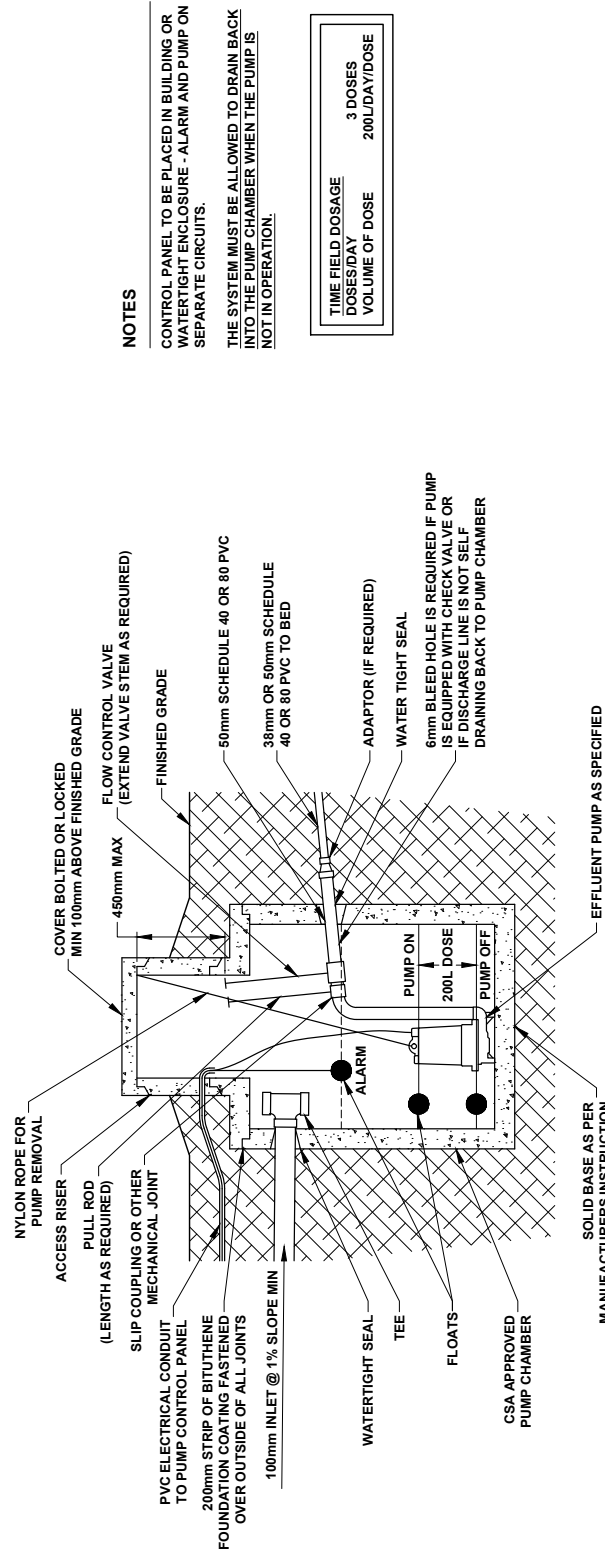

TYPICAL 2000L PUMP CHAMBER W/ ATLANTIC PURIFICATION SYSTEMS TIME DOSE PUMP

SCALE: NTS

GENERAL CONDITIONS

CONTRACTOR SHALL VERIFY LOCATION OF ALL WELLS, WATERCOURSES, LOT BOUNDARIES AND ALL ELEVATIONS PRIOR TO CONSTRUCTION (WITHIN 30.5m FROM THE LOCATION OF DISPOSAL SYSTEM)

BACKWASH WATER FROM WATER TREATMENT DEVICES MUST NOT BE DISCHARGED TO THE ON-SITE SEWAGE DISPOSAL SYSTEM.

ROOF, FOUNDATION AND LOT DRAINAGE MUST BE DIRECTED AWAY FROM THE DISPOSAL FIELD, SEPTIC TANK AND PUMP (SIPHON) CHAMBER.


THIS DIAGRAM IS TO BE READ IN COMBINATION WITH DOCUMENTS SUBMITTED WITH THE APPLICATION FOR APPROVAL TO INSTALL THE ON-SITE SYSTEM AND THE ATTACHED SPECIFICATIONS.

STEPS MUST BE TAKEN TO ENSURE THAT THE AREA IS NOT SUBJECT TO VEHICULAR TRAFFIC OF ANY OTHER DISTURBANCE SUCH AS EXCAVATION OR STOCKPILING OF EXCAVATED MATERIAL ETC., INSTALLATION OF A PHYSICAL BARRIER IS RECOMMENDED.

IT IS THE OWNERS RESPONSIBILITY TO ASSURE THAT THE CONSTRUCTION OF FOUNDATIONS, DRIVEWAY, WELL OR ANY OTHER DEVELOPMENT ON THE LOT WILL NOT IMPACT ON THE FEASIBILITY OF ON-SITE SEWAGE DISPOSAL FIELD INSTALLATION.

DISPOSAL SYSTEM MUST BE INSTALLED BY A CONTRACTOR LICENSED TO INSTALL ON-SITE SEWAGE DISPOSAL SYSTEMS IN NOVA SCOTIA.

ALL WORK MUST BE COMPLETED IN ACCORDANCE WITH THE NOVA SCOTIA ON-SITE SEWAGE DISPOSAL SYSTEMS REGULATIONS, ON-SITE SEWAGE SYSTEMS STANDARD AND CONDITIONS OF THIS APPROVAL.

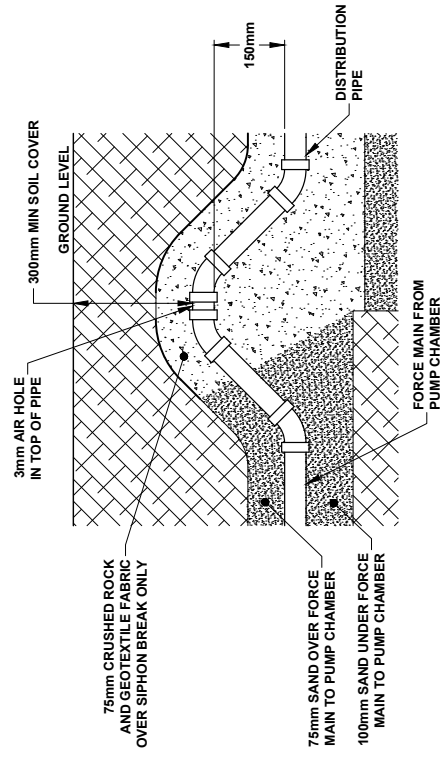

TYPICAL FORCE MAIN CONNECTION DETAIL

SCALE: NTS